


SECTION A-A

NOTES:

1. STABILIZED CONSTRUCTION SITE ACCESS SHALL BE CONSTRUCTED OF 3-6 INCH WASHED, CRUSHED, ANGULAR ROCK. MATERIAL SHALL BE PLACED TO A MINIMUM THICKNESS OF 12 INCHES.
2. LENGTH OF ENTRANCE SHALL BE A MINIMUM OF 50 FT. WIDTH SHALL BE A MINIMUM OF 10 FT. OR AS REQUIRED BY THE ADMINSTRATOR TO COVER ALL VEHICULAR INGRESS AND EGRESS. PROVIDE AMPLE TURNING RADII.
3. ACCESSES SHALL BE INSPECTED DAILY DURING PERIODS OF HEAVY USAGE, WEEKLY DURING NORMAL USAGE, AND AFTER EACH RAINFALL, WITH MAINTENANCE PROVIDED AS REQUIRED. PERIODIC TOP DRESSING OR REMOVE & REPLACE AS REQUIRED BY THE ADMINISTRATOR.
4. UNLESS APPROVED BY THE ADMINISTRATOR, CORRUGATED STEEL PANELS MAY NOT BE SUBSTITUTED FOR ROCK.

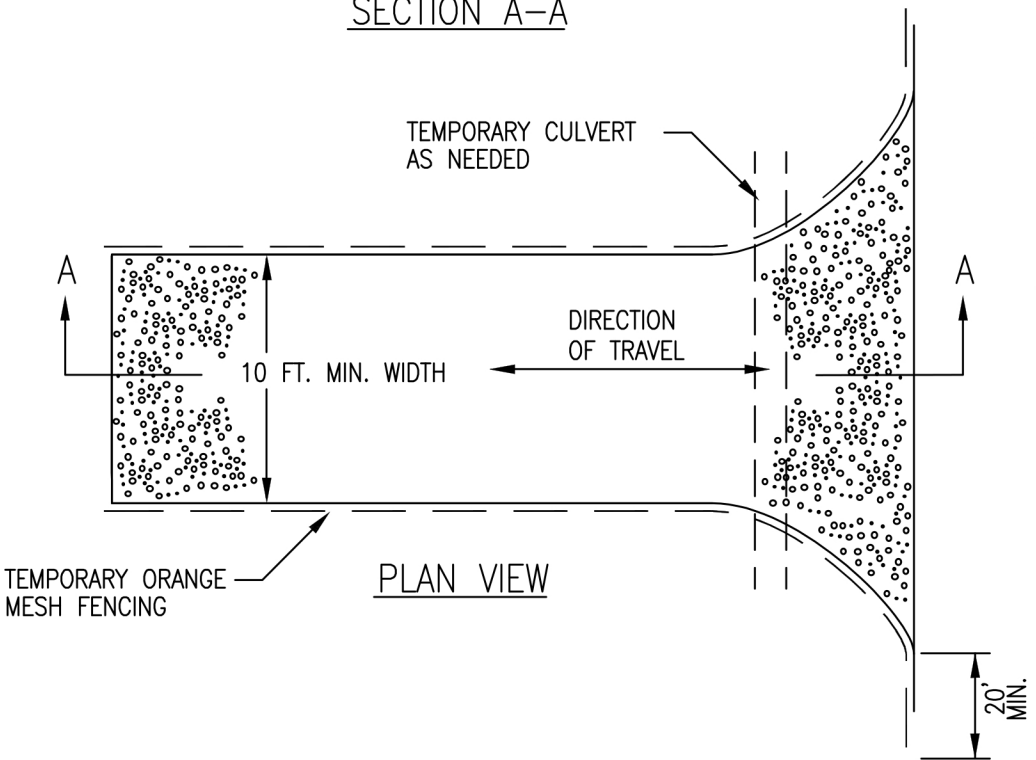

PLAN VIEW

DIRECTOR, DEPARTMENT OF WATER RESOURCES

<b>COUNTY OF SACRAMENTO</b>	
<b>STABILIZED CONSTRUCTION SITE ACCESS</b>	
DRAWN BY: STAFF SCALE: NONE DATE: 09/2024	<b>11-1</b>